

QED Environmental Systems

6155 Jackson Ave. Ann Arbor, MI 48103 Phone: 800-624-2026 Fax:734-995-1170

QED EZ-Stacker™ Air Stripper Operations and Maintenance Manual

QED Treatment Equipment, P.O.Box 3726, Ann Arbor, MI 48106
Phone: (800)-624-2026, Fax: (734)-995-1170
QED p/n 95164 February 16, 1996 Rev 3/18/04

QED EZ-Stacker™ Operations and Maintenance Manual

Introduction

This manual contains instructions for installing, start-up and operation of a QED EZ-Stacker™ Air Stripper for the treatment of dissolved-VOC-contaminated waters. The EZ-Stacker™ Air Stripper is a sieve tray type of stripper which accomplishes mass transfer by creating a large amount of fine air bubbles into which volatile organics are stripped. Efficient stripping with this type of a unit is affected by:

- Water temperature-- higher temperature allows better stripping
- Specific compound being stripped--higher Henry's Law constant equals better stripping
- Air to water ratio--the higher the air to water ratio (air flow for a given water flow) the better the stripping
- Stripper efficiency--certain design elements, such as tray design affect stripping efficiency
- Surfactants (soaps, cleaning agents, etc.) and oil/grease can negatively impact stripping efficiency

From an operation standpoint the single most important factor is ensuring that the recommended amount of clean air is flowing through the stripper. Air flow is most affected by tray fouling (typically with precipitated iron oxides) which creates back pressure on the blower and causes it to operate at a lower air flow point on its curve. Maintaining clean trays and using the excess capacity on the blower can help control fouling conditions. Occasional gasket replacement can be anticipated depending on the frequency of stripper disassembly and reassembly. The stripper blowers and any transfer pumps should be regularly maintained based upon the manufacturer's maintenance schedule. All other stripper components are largely maintenance free. Please refer to Figure 1 at the end of this manual for understanding terminology.

Installation

Installing Skid Mounted Systems

Complete skid mounted systems arrive at your site as shown in Figure 1. A system of this type is mounted, piped and optionally wired at the factory. All components and functions are 100% wet checked.

Influent piping. Connect system influent piping to the influent feed pump or directly to the stripper at the piping connection located on the top of the stripper. Factory piped influent feed pump systems use flexible pressure hose between the pump and the stripper influent piping connection and includes a check valve to prevent air backup into a transfer tanks or oil water separator. If the stripper

influent is plumbed directly on site, a flexible hose connection is recommended to ease stripper disassembly and reassembly during use.

Effluent piping. Factory piped effluent discharge pump systems use flexible pressure hose between the stripper discharge piping connection, located at the bottom of the stripper sump and the effluent discharge pump. Factory installed gravity discharge piping connects at the same discharge point on the stripper sump and utilizes a gravity drain kit which includes a siphon break and water head seal. If the stripper is plumbed on site connect the discharge pump to the stripper sump at the discharge connector. Gravity drain piping should be a minimum of 2-3" in diameter (depends on the model) and designed as shown in Figures 4 or 5.

Blower piping. *Important! Total sump pressures should never exceed 50" WC! This will void QED Warranty.* The blower piping that connects the blower to the air stripper are typically of an inverted-U shape, with a high leg to reduce the chance of flooding the blower in the event of an unforeseen flood condition.

On EZ-2.xP models, QED typically use regenerative blowers sized so that they do not require much, if any, throttling of the airflow. Regenerative blowers are limited in the amount of throttling that can be applied, since added backpressures may cause the blower motor to run above full-load-amp condition and cause the blower motor to overheat. If customer is installing their own piping kit on an oversized regenerative blower, it is recommended that an air dilution/bleed valve be installed in the blower piping to provide flexibility in controlling airflow.

Stripper Air Discharge Stack. The stripper discharge pipe is located on top of the air stripper and is 4" or 6" in diameter (depending upon model). The wider section of the discharge porting contains the demister element which removes entrained water droplets from the air exiting the stripper. Coalesced water droplets collect on the demister and then fall back into the stripper top tray. Piping or ducting for the stripper discharge stack should be of equal diameter or larger to avoid creating excess back pressure on the stripper blower. A flexible coupling, such as a Fernco brand, is recommended to connect the discharge pipe to the stripper air discharge stack to ease unit disassembly for cleaning. It is also important to pipe the air stripper air discharge such that it is not in proximity with the air stripper blower inlet; this minimizes the risk of sending already-contaminated air back into the air stripper and reducing stripper performance.

Sensors. Normal sensors used with this type of air stripper include a sump high level alarm float sensor, sump low air pressure sensor and optional discharge pump on-off float sensor. If these sensors are supplied with the stripper they will be installed in the stripper sump and piping. Often the system control panel must be mounted in a remote location from the stripper (in cases where the location is classified as an explosion hazard area.) If the panel is to be remotely-mounted a licensed electrician should hook the stripper sensors up to the panel. It is

important that these sensors be tested prior to operating the stripper. A frequent cause of improperly operating systems are float sensors which act in the opposite sense of that which the control panel expects (normally-open vs. normally-closed). It is also important to conform to electrical code requirements for classified areas; sensors may require intrinsically safe barriers.

Installing Bare Stripper Sump and Tray Systems

Bare stripper sump and tray systems are provided in cases where the contractor will mount the stripper to a user supplied skid or concrete pad. These systems are supplied with a second gasket compression ring that anchors the gasket compression rods at the bottom of the stripper. The bottom gasket compression ring has tabs protruding around its circumference which allow mounting of the ring to a skid or concrete pad.

If the blower is purchased from the factory it is recommended that the blower piping package also be purchased. If the contractor is supplying their own blower it must meet the typical performance specifications listed below to achieve the desired contaminant removals. If the air stripper is built to non-standard parameters, the performance specifications below may not apply.

<u>Air Flow:</u>	140 cfm (for EZ-2.xP) or 280 cfm (for EZ-4.xP) at maximum system back pressure
<u>Pressure:</u>	Sufficient to overcome tray, piping and air treatment process back pressures at a flow rate of 140cfm. <i>Important! Total sump pressures should never exceed 50" WC! This will void QED Warranty.</i>
<u>Tray Back Pressures</u>	16-20"H ₂ O for 4-trays; 24-30"H ₂ O for 6-trays (assuming no add'l pressure from equipment downstream of air stack).

The blower piping should include a high leg which acts to reduce the risk of flooding the blower if the high sump level sensor was to malfunction in the stripper sump. See Figures 2 and 3 (for models EZ-2.xP and EZ-4.xP, respectively) for examples of proper blower piping configurations.

The EZ-2.xP models typically use regenerative blowers sized so that they do not require much, if any, throttling of the airflow. Regenerative blowers are limited in the amount of throttling that can be applied, since added backpressures can cause the blower motor to run above full-load-amp conditions and overheat. If customer is installing their own piping kit on an oversized regenerative blower, it is recommended that an air dilution/bleed valve be installed in the blower piping to provide flexibility in controlling airflow. A throttle valve is shown in Figure 1; a dilution/bleed valve is not shown.

Influent and effluent piping and sensor hook-up should be as described in the section on skid mounted systems, above.

Startup

The EZ-Stacker™ stripper is designed to start up dry without priming the sealpot or throttling the blower. The stripper blower should be running before water is introduced to the stripper. Water flows into the top tray and proceeds tray by tray to the stripper sump. Stripper seal pots fill with water and allow complete start up during intermittent operation. IMPORTANT: Before starting the system verify correct blower motor rotation (plus any other motors within the treatment system).

Verify that the sump air pressure is 16-20" H₂O for 4-tray systems or 24-30" H₂O for 6-tray systems (it is normal to see lower sump pressures at the very start of operation before the seal pots and trays fill with water.) Sump pressures lower than these values may indicate either a blower throttle which is not sufficiently open or insufficiently-compressed tray seal gaskets. *If the system configuration includes additional backpressure (from vapor phase carbon, for example), the sump pressures will be greater than these values. it is important that the blower is sized to accommodate the added pressures, being careful that air stripper sump pressures never exceed 50" WC. Total sump pressures exceeding 50" WC will void QED Warranty!* Check the blower piping throttle valve and make sure the hold-down rods are tightened firmly, but not over tightened. The hold-down tensioning springs should be compressed to a length of 3-1/2 inches for proper gasket sealing.

Step by step startup includes:

1. Power the main control panel on.
2. Turn the blower on. For QED supplied control panels set the motor operation switch to AUTO.
3. Turn the stripper feed pump on (allow water to enter the stripper for gravity feed systems.) For QED supplied control panels set the motor operation switch to AUTO (some systems have a delay timer on the feed pump--check control panel documentation for details.)
4. Turn the discharge pump on. For QED supplied control panels set the motor operation switch to AUTO.
5. Open or close the blower air flow throttle and air dilution valve (if required) to produce a sump pressure reading of 16-20"H₂O for 4-tray systems or 24-30"H₂O for 6-tray systems (these are typical values, but these may differ depending whether any other pressures need to be accounted for. NOTE: It is normal to see

lower sump pressures at the very start of operation due to sealpots and trays filling with water.

Operation

Stripper operation is normally automatic. One option for QED supplied control panels is a blower time-out relay which continues to run the blower for several minutes after the feed pump stops. Continued blower operation insures that any residual water left on the stripper trays has sufficient time to strip before the blower shuts down. A time of at least 15 minutes is recommended. Strippers with start-stop cycles of more than 2-4 times per hour should be set to run continuously.

For sites with high dissolved iron content stripper cleaning may be required. Tray fouling is evidenced by increasing sump back pressure. Opening the blower air flow throttle will allow continued operation in some situations and will lengthen the time between tray cleanings. It is most important to maintain an air flow of 140cfm through the unit. If the stripper air flow decreases the stripping efficiency decreases. Below 100 cfm air flow the stripper will start begin to “weep” water through the tray holes from upper trays to lower trays before the water has had sufficient residence time for removal. If stripper performance falls off, check for tray fouling or a blower air flow throttle that is not opened sufficiently.

Maintenance

Tray fouling due to iron precipitation, solids loading, or bio-fouling is evidenced by increased sump pressures, decreased stripper performance (removal rates not being met) or noticeable discoloration on the trays. Stripper cleaning is required when trays are fouled.

Step by step cleaning includes:

1. Before working on any equipment lock-out power to the unit.
2. Disconnect the stripper discharge pipe from the stripper exhaust stack piping.
3. Unscrew the hold-down rod nuts (cranks) and remove the gasket hold-down ring.
4. Remove the stripper trays. Please note the tray seal pots will have some water remaining in them.
5. Using a pressure washer and medium bristle brush clean any residue from the trays surfaces, concentrating on the sieve holes. DO NOT USE SOAP or cleaning agents unless they will be thoroughly rinsed from the trays; soap residue can affect stripper performance.

6. For hard to remove scales and precipitates a dilute (5%-10%) muriatic acid and water solution can be used to rinse or soak the trays. Be certain to completely rinse the solution off the trays before reassembling the unit.
7. Reassemble the trays--note that they are numbered and that a mark is used to assist in proper alignment of the trays during reassembly. Check to make sure the gasket is still seated correctly and undamaged.
8. Reinstall the gasket hold-down ring and retension the hold-down rod nuts (cranks.) The hold-down tensioning springs should be compressed to a length of 3-1/2 inches for proper gasket sealing.
9. Reattach any pipe and exhaust stack connections.
10. Follow Start-Up instructions, above.

Other stripper maintenance items include:

1. Periodically check blower for vibration. Bearings may require eventual service or conditions of excessive motor start / stop cycles may lead to premature motor or blower failure.
2. Check gasket condition during disassembly for cleaning. The gasket is designed to allow numerous assembly and disassemblies before requiring replacement. Contact QED for information and pricing about gasket replacement kits.
3. The stripper demister element is essentially maintenance free, although dried inorganic residue can build up within the demister and affect demister operation. This condition is evidenced in water droplets not being removed by the demister and blowing out of the stripper exhaust stack--occasionally on start-up water is discharged from the stripper stack, which is normal. The demister may be cleaned with a dilute muriatic and water solution (5%-10%) as instructed for tray cleaning.
4. Solids may build up in the sump. These solids can be suctioned out during tray cleaning operations.
5. Periodically check the structural integrity of the stripper sump, trays and top. Check bulkhead nuts for snugness. Cracks or loose fittings will normally be evidenced by water leakage.

Troubleshooting

Some common problems include:

1. *Leaks.* Leaks around trays or at the sump indicate an insufficiently compressed tray gasket. Make sure the hold-down tensioning springs are compressed to a length of 3-1/2 inches for proper gasket sealing. Also check for damaged gaskets (over compressed gaskets, cut gaskets, loose gaskets, etc.) Damaged gaskets

- should be replaced with new gaskets. Contact QED for information and pricing about gasket replacement kits. For leaks at fittings, check for fitting tightness.
2. *Stripper not meeting removal requirements.* Contaminated stripper air is the most common reason for poor stripping performance within the low-ppb concentration range--make sure that the stripper blower intake is drawing in clean, uncontaminated air. Check for sufficient air flow through the stripper. Check that trays are clean. Check that demister is not clogged or causing increased blower back pressure. Check any stripper air discharge treatment units for increased back pressure. Check that stripper influent flow or concentration has not increased beyond the design basis used to predict stripper performance. Make sure that the influent does not have surfactants (soaps, etc.), oils, grease, or other immiscible phases in the influent stream. Surfactants are evidenced by increased foaming through the stripper unit.
 3. *Sump pressure not at recommended levels.* Check sump pressure gauge tubing for accumulated water that could impair gauge performance. Check gaskets for damage and proper seating. Check for proper hold-down spring tensioning. Check blower piping connections for leakage. Check blower for proper rotation. Check design of gravity drain piping if piping is not QED-supplied. Check blower intake filter / silencer (if included) for clogging. Order new filter elements from QED.
 4. *Stripper cleaning frequency seems excessive.* At sites with high iron loading, consider iron sequestering agents or other technology which will reduce/prevent iron precipitation or allow for easier cleaning.

Please investigate all the above-mentioned items while troubleshooting. For additional problem solving assistance contact QED Service at:

Phone: 1-800-624-2026
FAX: 1-734-995-1170
24 Hour Service Hot Line: 1-800-272-9559

Please have the following information ready for the QED Service person:

1. Identify the product or system involved by QED order number.
2. Specify where, when, and from whom the product was purchased.
3. Describe the nature of the defect or malfunction.

QED TREATMENT EQUIPMENT WARRANTY

QED Environmental Systems Inc. (QED) warrants to the original purchaser of its products that, subject to the limitations and conditions provided below, the products, materials and/or workmanship shall reasonably conform to descriptions of the products and shall be free of defects in materials and workmanship. Any failure of the products to conform to this warranty will be remedied by QED in the manner provided herein.

QED warrants the equipment components of its manufacture for a period of one (1) year from date of delivery. Our sole obligation during this warranty will be to repair or replace (at our option) the defective components. We are not responsible for consequential damages. Labor costs are not included.

Purchaser's exclusive remedy for breach of said warranty shall be as follows: if, and only if, QED is notified in writing within the applicable warranty period of the existence of any such defects in the said products, and QED upon examination of any such defects, shall find the same to be within the term of and covered by the warranty running from QED to Purchaser, QED will, at its option, as soon as reasonably possible, replace or repair any such product, without charge to Purchaser. If QED for any reason, cannot repair a product covered hereby within four (4) weeks after receipt of the original Purchaser's notification of a warranty claim, then QED's sole responsibility shall be, at its option, either to replace the defective product with a comparable new unit at no charge to the Purchaser, or to refund the full purchase price. In no event shall such allegedly defective products be returned to QED without its consent, and QED's obligations of repair, replacement or refund are conditioned upon the Purchaser's return of the defective product to QED.

IN NO EVENT SHALL QED ENVIRONMENTAL SYSTEMS INC. BE LIABLE FOR CONSEQUENTIAL OR INCIDENTAL DAMAGES FOR BREACH OF SAID WARRANTY.

The foregoing warranty does not apply to major subassemblies and other equipment, accessories, and other parts manufactured by others, and such other parts, accessories, and equipment are subject only to the warranties supplied by their respective manufacturers. In the event of failure of any such product or accessory, QED will give assistance to Purchaser in obtaining from the respective manufacturer whatever adjustment is reasonable in light of the manufacturer's own warranty.

THE FOREGOING WARRANTY IS IN LIEU OF ALL OTHER WARRANTIES, EXPRESSED, IMPLIED OR STATUTORY (INCLUDING BUT NOT LIMITED TO THE WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE), WHICH OTHER WARRANTIES ARE EXPRESSLY EXCLUDED HEREBY, and of any other obligations or liabilities on the part of QED, and QED neither assumes nor authorizes any person to assume for it any other obligation or liability in connection with said products, materials and/or workmanship.

It is understood and agreed that QED shall in no event be liable for incidental or consequential damages resulting from its breach of any of the terms of this agreement, nor for special damages, nor for improper selection of any product described or referred to for a particular application.

This warranty will be void in the event of unauthorized disassembly of component assemblies. Defects in any equipment that result from abuse, operation in any manner outside the recommended procedures, use and applications other than for intended use, or exposure to chemical or physical environment beyond the designated limits of materials and construction will also void this warranty.

The equipment is warranted to perform as specified under the conditions specified here and within the air stripper model or QED will make the necessary changes at no cost to the owner. Some restrictions apply. Requirements for warranty consideration include, (but are not limited to):

1. Current operating conditions do not differ from the previously-modeled conditions.
2. The system should be cleaned regularly to maintain system performance.

3. The equipment is installed, operated and maintained according to QED's instruction or non-QED manufactured subassembly manufacturer's instructions.
4. Air stripper influent air is not "dirty" (does not contain VOC's, etc.).
5. No surfactants, oils, greases, or other immiscible phases are present in the water.
6. Each influent contaminant does not exceed 25% of its maximum solubility under modeled conditions.


QED shall be released from all obligations under all warranties if any product covered hereby is repaired or modified by persons other than QED's service personnel unless such repair by others is made with the consent of QED. If any product covered hereby is actually defective within the terms of this warranty, Purchaser must contact QED for determination of warranty coverage. If the return of a component is determined to be necessary, QED will authorize the return of the component, at owner's expense. If the product proves not to be defective within the terms of this warranty, then all costs and expenses in connection with the processing of the Purchaser's claim and all costs for repair, parts and labor as authorized by owner hereunder shall be borne by the Purchaser.

In the event of air stripper performance issues, QED may require customer to conduct a variety of troubleshooting steps. These include, but are not limited to, modifying operational parameters, cleaning air stripper system, modifying (temporarily or permanently) process piping, and obtaining reasonable and necessary influent/effluent samples. These steps are the responsibility of the customer and will be conducted by customer prior to consideration by QED for a site visit. These steps and the associated costs incurred are the responsibility of the customer, regardless of future action. Should customer request a site visit by QED or accept a site visit offer by a QED-trained technician, the visit and associated costs: a) will be the responsibility of the customer at \$500/day, plus travel, lodging, and meals, if the visit finds improper sampling, process piping installation, or equipment operation inconsistent with QED's Operation and Maintenance Manual; or b) will be the responsibility of QED if the visit finds QED responsible for the performance issue(s) raised.

The original Purchaser's sole responsibility in the instance of a warranty claim shall be to notify QED of the defect, malfunction, or other manner in which the terms of this warranty are believed to be violated. You may secure performance of obligations hereunder by contacting the Customer Service Department of QED and:

1. Identify the product or system involved by QED order number.
2. Specify where, when, and from whom the product was purchased.
3. Describe the nature of the defect or malfunction covered by this warranty.
4. If applicable, send the malfunctioning component, *after receiving a Return Authorization Code (RAC) Number by the QED Service Department, to:*

QED Environmental Systems Inc.
6241 Jackson Road
Ann Arbor, MI 48103
Attn: R.A.C. No. (Return Authorization Code Number provided by QED Service Dept.)

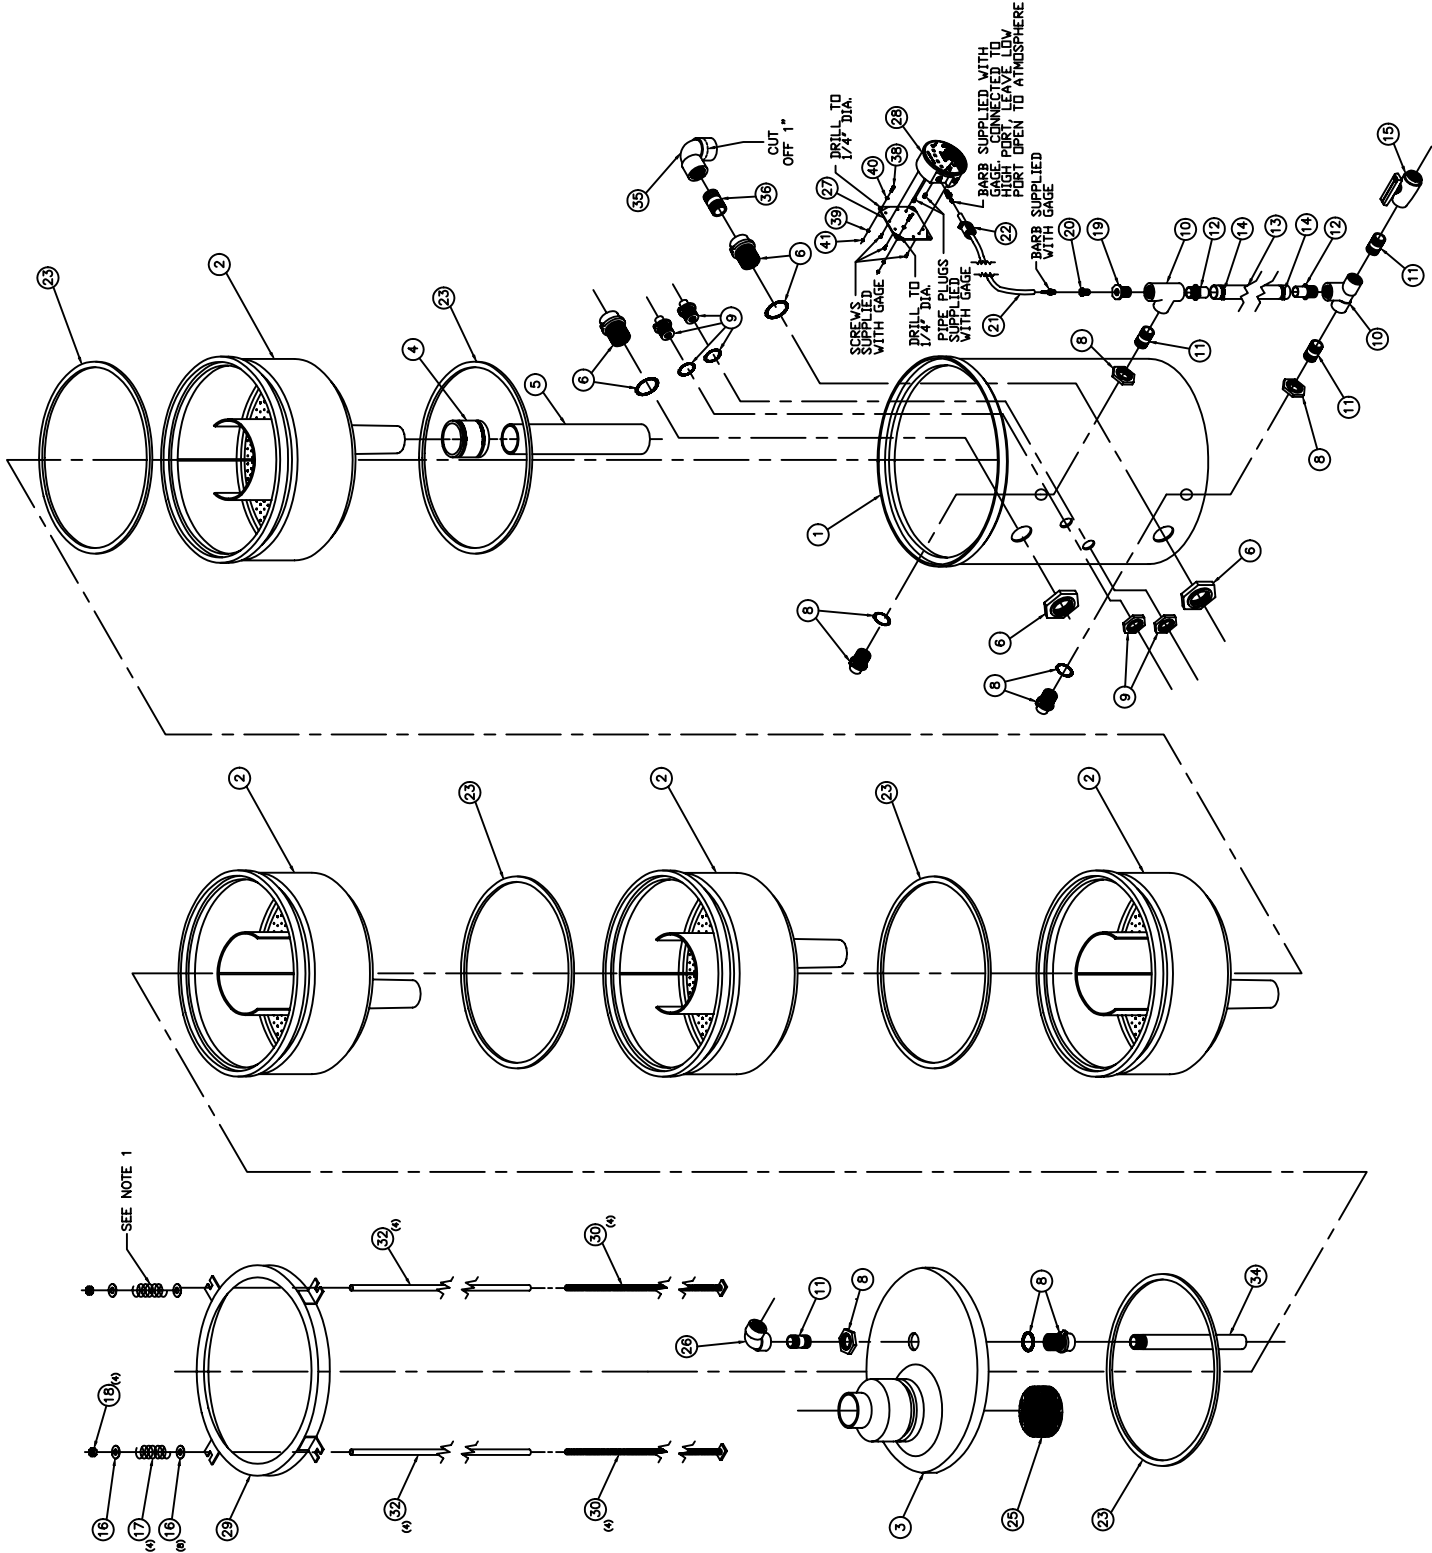


ITEM QTY	DESCRIPTION	PART #
41	NUT 1/4"	EXPENSED
40	WASHER, FLAT 1/4"	EXPENSED
39	WASHER, LOCK 1/4"	EXPENSED
38	BOLT, 1/4" HEX HD.	EXPENSED
37		
36	NIPPLE, CLOSE 2" PVC	802074
35	ELBOW 2" 90 DEGREE PVC THREADED	802034
34	PIPE 1" PVC 12.50 LG (THD. ONE END)	802162
33		
32	TUBING, NYLON 1/2" OD X 3/8" ID 68" LG	35097
31		
30	TIE ROD ASSEMBLY	804042
29	RING, TOP HOLD DOWN 27.63 OD	804040
28	MAGNEHELIC DIFFERENTIAL PRESSURE GAGE INCLUDES THE FOLLOWING: SCREWS, 6-32 RD. HD. (2) PIPE PLUG 1/8" (2) BARBS, 1/8" MPT X 3/16" BARB (2)	EZPGAUGE
27	BRACKET MOUNTING	805179
26	ELBOW 90 DEGREES PVC 1" MPT SCH 80	802037
25	DELUSTER 3 PADS OF 37/97 3.60 HIGH X 7.50 DIA.	804052
24		
23	GASKET, ROUND	804038
22	PINCH VALVE	36559
21	TUBING, CLEAR 5/16" O.D. X 3/16" I.D.	802248
20	REDUCER, BUSHING 1/4" X 1/8" BRASS	34103
19	REDUCER, BUSHING 1" X 1/4" BRASS	803054
18	NUT, 3/8-16 ZINC PLATED STEEL	805180
17	SPRING, NICKEL PLATED	805214
16	WASHER, FLAT 3/8 ZINC PLATED STEEL	805181
15	VALVE, BALL PVC 1" FPT X 1" FPT	802196
14	CLAMPS, HOSE 13/16 X 1 1/2"	805055
13	TUBING, CLEAR PVC 1" I.D. 3/16" WALL	802236
12	BARB, NYLON 1" MPT X 1" BARB	805020
11	NIPPLE, CLOSE PVC 1" SCH 80	802103
10	TEE, PVC 1" FPT SCH 80	802028
9	BULKHEAD FITTING (RAVEN) 1/2" FPT	802169
8	BULKHEAD FITTING (RAVEN) 1" FPT	802171
7		
6	BULKHEAD FITTING 2" FPT (RAVEN)	802174
5	PIPE, PVC 3" 17.50 LG REF.	802156
4	FERNCO 3" COUPLER	802166
3	TRAY, TOP	804067
2	TRAYS, WITH SECONDARY PARTS	804068
1	SUMP	804069

UNLESS OTHERWISE SPECIFIED, DIMENSIONS ARE IN INCHES AND INCLUDE PLATING REMOVE ALL BURRS TOLERANCES UNLESS OTHERWISE SPECIFIED
 DRAWN BY KM 11-14-95
 CHECKED BY LN 12-5-95
 APPROVED BY DATE
 MPT. APPROVAL
 MATERIAL
 FINISH
 USED ON
 NEXT ASBY

Q.E.D.
 ENVIRONMENTAL SYSTEMS INC.
 6155 JACKSON ROAD, ANN ARBOR, MI.

TITLE
 EZ-2.4 P
 ASSEMBLY/BOM/KIT
 DRAWING NUMBER EZ-2.4P
 SCALE N.T.S. SHEET 1 OF 1

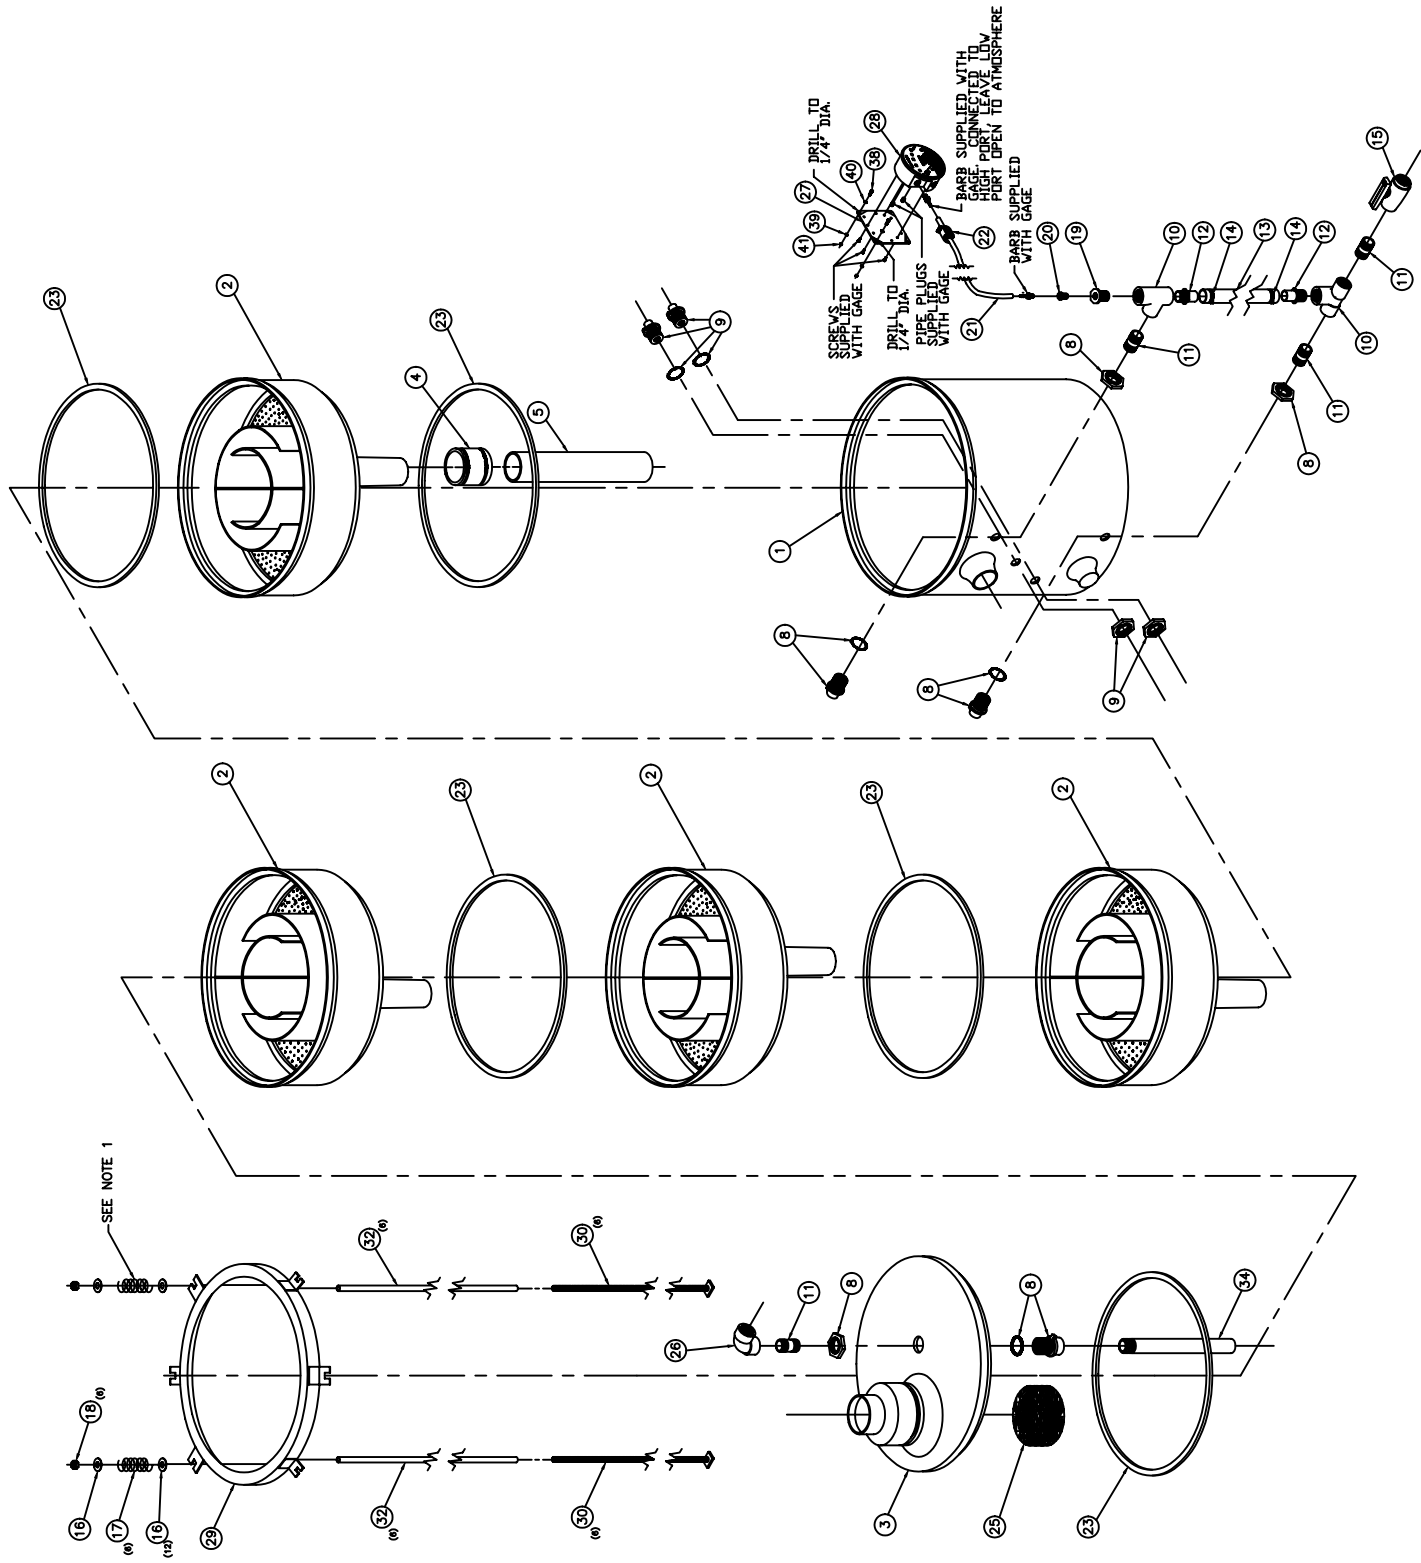

ITEM QTY	DESCRIPTION	PART #
4.1	NUT 1/4"	EXPENSED
4.0	WASHER, FLAT 1/4"	EXPENSED
3.9	WASHER, LOCK 1/4"	EXPENSED
3.8	BOLT 1/4" HEX HD.	EXPENSED
3.7		
3.6		
3.5		
3.4	PIPE 1" PVC 12.50 LG (THD. ONE END)	802162
3.3		
3.2	TUBING, NYLON 1/2" OD X 3/8" ID 66" LG	35097
3.1		
3.0	TIE ROD ASSEMBLY	804042
2.9	RING, TOP HOLD DOWN 37.88 OD	804060
2.8	MAGNEHELIC DIFFERENTIAL PRESSURE GAGE EZFPAUGE INCLUDES THE FOLLOWING: SCREWS, 6-32 RD. HD. (2) PIPE PLUG 1/8" (2) BARBS, 1/8" MPT X 3/16 BARB (2)	805179
2.7	BRACKET, MOUNTING	802037
2.6	ELBOW 90 DEGREES PVC 1" MPT SCH 80	804053
2.5	DEMIETER 3 PADS OF 37/97 3.60 HIGH X 10" DIA.	
2.4		
2.3	GASKET, ROUND	804059
2.2	PINCH VALVE	36559
2.1	TBD TUBING, CLEAR 5/16" O.D. X 3/16" I.D.	802248
2.0	REDUCER, BUSHING 1/4" X 1/8" BRASS	34103
1.9	REDUCER, BUSHING 1" X 1/4" BRASS	803054
1.8	NUT, 3/8-16 ZINC PLATED STEEL	805180
1.7	SPRING, NICKEL PLATED	805214
1.6	WASHER, FLAT 3/8 ZINC PLATED STEEL	805181
1.5	WASHER, BALL PVC 1" FPT X 1" FPT	802196
1.4	CLAMPS, HOSE 13/16 X 1 1/2"	805055
1.3	TUBING, CLEAR PVC 1" I.D. 3/16" WALL	802236
1.2	BARB, NYLON 1" MPT X 1" BARB	805020
1.1	NIPPLE, CLOSE PVC 1" SCH 80	802103
1.0	TEE, PVC 1" FPT SCH 80	802028
9	BULKHEAD FITTING (RAVEN) 1/2" FPT	802169
8	BULKHEAD FITTING (RAVEN) 1" FPT	802171
7		
6		
5	PIPE, PVC 3" 17.50 LG REF.	802156
4	FERRICO 3" COUPLER	802166
3	TRAY, TOP	804049
2	TRAYS, WITH SECONDARY PARTS	804050
1	SUMP	804051

UNLESS OTHERWISE SPECIFIED, DIMENSIONS ARE IN INCHES AND INCLUDE PLATING REMOVE ALL BURRS TOUGHENES TO 100% ± 0.05 INCHES ± 1/16" OTHER TOLERANCES AS SPECIFIED

4-4 EZ STACKER USED ON NEXT ASY

FINISH

SCALE N.T.S. SHEET 1 OF 1

Q.E.D. ENVIRONMENTAL SYSTEMS INC. 6155 JACKSON ROAD, ANN ARBOR, MI.

TITLE: EZ-4.4 P ASSEMBLY/BOM/KIT

DRAWING NUMBER: EZ-4.4P

REV #